

# NPB SERIES BACNET COMMUNICATING CONTROLLER

# NENUTEC<sup>®</sup>

INNOVATIVE MEMBER OF SWIS<sup>+</sup>TEC

**NENUTEC ASIA PACIFIC PTE LTD**  
7030 Ang Mo Kio Ave 5  
#03-56 Northstar @ AMK  
Singapore 569 880




 (65) 6570 3233

 (65) 6570 6783

 [info@nenutec.com.sg](mailto:info@nenutec.com.sg)

# NPB SERIES BACNET COMMUNICATING CONTROLLER

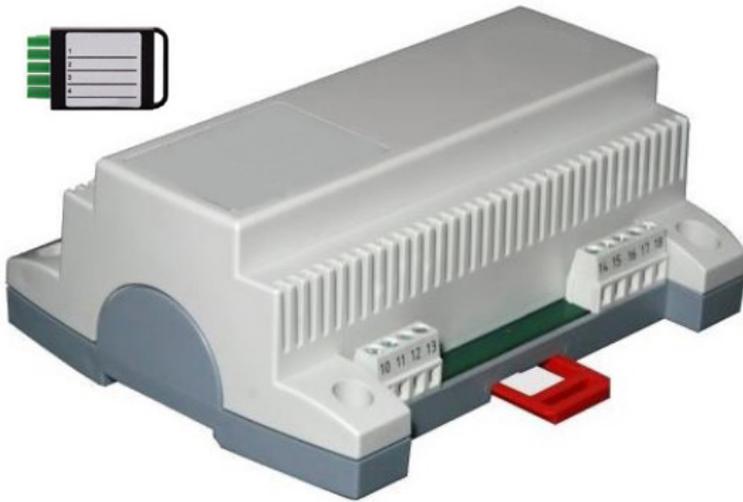

## NPB SERIES

NPB series BacNet Communicating Cabinet/Box mounted Controller.

The NPB is programmable electronic universal controller with communication capabilities.

## PRODUCT FEATURE



- BACnet™ MS/TP communication over RS485
- BACnet™ B-ASC device profile
- Models for 24VAC or 230VAC power supply
- RS485 bus communication with remote operation terminal NDB500
- Universal PI and/or binary control for any analog input/output signal and range
- Multiple auxiliary functions: heat-cool auto changeover, automatic enable, set point compensation
- Free heating or cooling with economizer function based on enthalpy or temperature
- Differential, averaging, min and max functions
- Cascading of control loops
- 8 free assignable alarm or interlock conditions, Selectable state of each output on alarm condition
- Transmitter function for inputs and set points
- Functions for dehumidifying, set point shift and many more
- Password protected and lockable settings
- Annual and 7-day programmable schedules for change of operation mode, set points and position of manual outputs. Note: no real time clock included. Time need to be synced every 24 hours.
- Clone parameter sets with plug-in memory card – easily transport application parameters to multiple controllers
- Program and monitor using free pc software: EasySet!

## TECHNICAL SPECIFICATION


<b>MODEL NUMBER</b>	<b>NPB -14273</b>	2 Loop, 4 passive inputs, 7 Binary outputs, 3 Analog outputs Controller 24VAC/DC with BACnet® MS/TP
	<b>NPB -24273</b>	2 Loop, 4 passive inputs, 7 Binary outputs, 3 Analog outputs Controller 230VAC/DC with BACnet® MS/TP
<b>POWER CONSUMPTION</b>	Max. 10 VA	
<b>SIGNAL INPUT</b>	Passive input	X1 to X4, Passive Temperature NTC or open contact
	Analog input	X5 to X6
	Input signal	0...10 V
	Resolution	9.76 mV (10 bit)
	Impedance	98kΩ
<b>SIGNAL OUTPUT</b>	Analog outputs	Y1 to Y3
	Output signal	DC 0...10 V
	Resolution	9.76 mV (10 bit)
	Maximum load	≥1kΩ
<b>RELAYS OUTPUT</b>	DO1, DO2, DO3, DO4	0...250 VAC, 0...30 VDC full-load current 3A (1.5)
	DO7	0...250 VAC, 0...125 VDC full-load current 10A (5A)
<b>TRIAC OUTPUT</b>	DO5 (T1), DO6 (T2)	24VAC (provided by NPB), 0.2A max. (switched to M) Note: Combined load of both TRIAC and any device connected to power output must not exceed 5VA!
<b>CONNECTION TO REMOTE TERMINAL</b>	Hardware interface	RS485 in accordance with EIA/TIA 485
	Cabling	Twisted pair cable category 5 or 6
<b>NETWORK</b>	Hardware interface	RS485 in accordance with EIA/TIA 485
	Max nodes per network	128
	Nominal Max nodes per segment	64 (Nenutec devices only)
	Conductors	Shielded Twisted Pair (STP) cable
	Impedance	100 - 130 ohm
	Nominal capacitance	100 pF/m 16pF/ft. or lower
	Galvanic isolation	The communication circuitry is isolated
Line termination	A line termination resistance (120 ohm) shall be connected between the terminals (+) and (-) of the furthestmost node of the network	
Network topology	Daisy chain according EIA/TIA 485 specifications	
Recommended maximum length per chain	1200 m (4000 ft.)	
<b>BACNET™ COMMUNICATION STANDARD</b>	BACnet™ MS/TP Master on RS485	
<b>BACNET™ COMMUNICATION SPEED</b>	9600, 19200, 38400, 57600, 76800, 115200	
<b>ENVIRONMENT</b>	Operation temperature & RH: 0 to 50°C; <85% RH Non-condensing	
<b>CERTIFICATION</b>	CE with EMC directive 2004/108/EC & Low voltage directive 2006/95/EC	
<b>DEGREE OF PROTECTION</b>	IP00 to EN 60 529	
<b>BODY MATERIAL</b>	Fire Proof ABS plastic	
<b>DIMENSIONS (H X W X D)</b>	57 x 147 x 115 mm (2.3 x 5.8 x 4.5 in)	
<b>WEIGHT</b>	NPB-14273: 380g (13.4 oz.) NPB-24273: 660g (23.3 oz.)	

# NPB SERIES BACNET COMMUNICATING CONTROLLER

## WIRING DIAGRAM

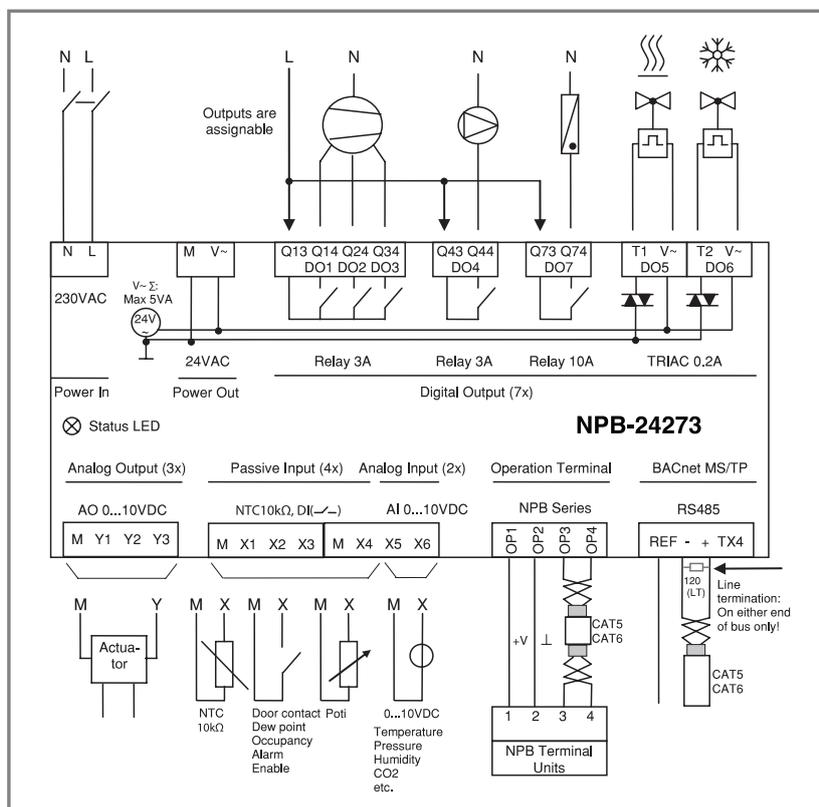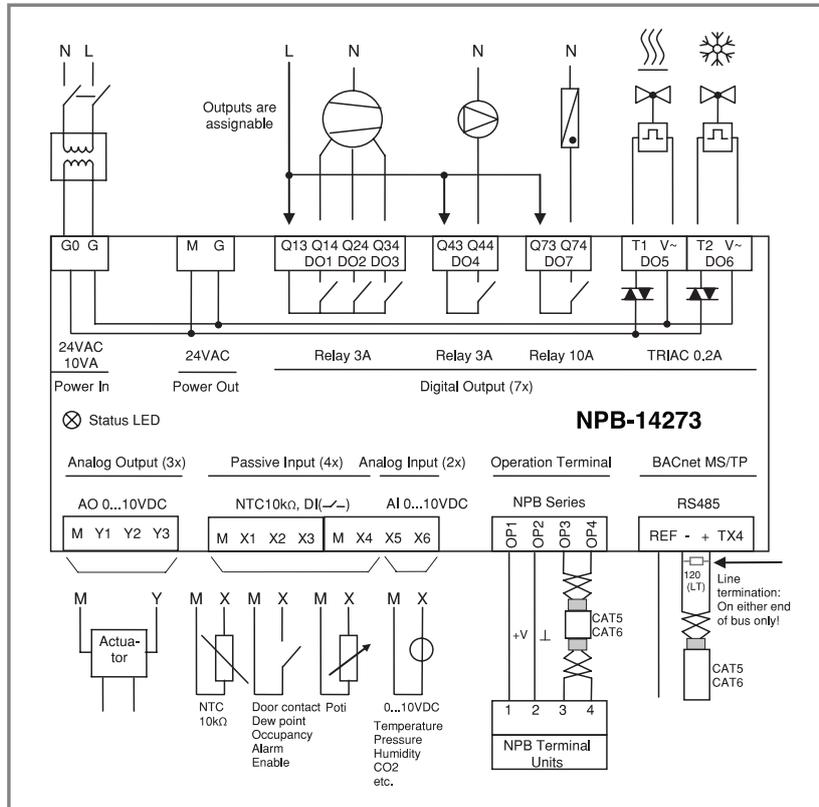

# BUS CONNECTION

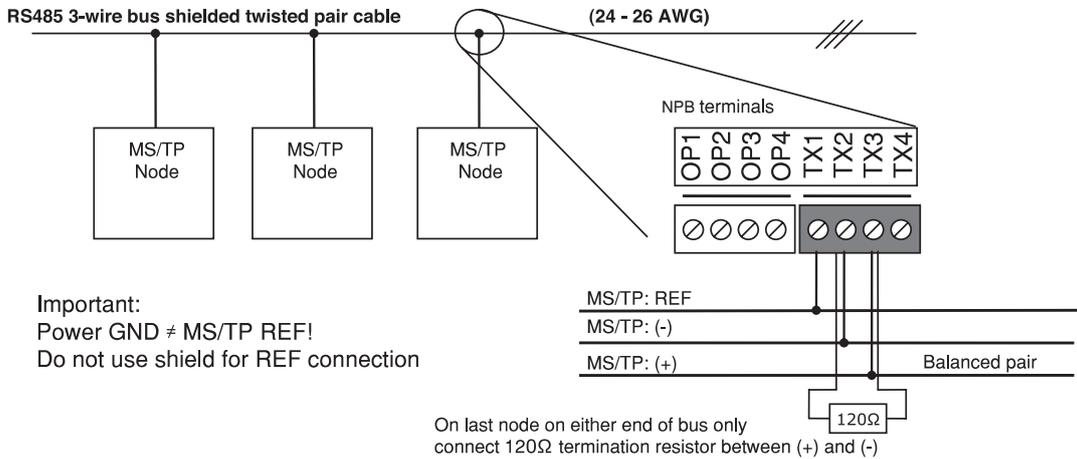

## FAIL SAFE BIASING

The device supports fail-safe biasing (line polarization). 680Ω per wire, maximum 1 set per RS485 segment

## SHIELD CONNECTION

See Ashrae standard 135 for detailed recommendation regarding how to connect the shield depending on type of nodes present in network. Nenuotec Controls bus modules are isolated devices.

## WIRE TYPE

An EIA-485 network shall use shielded, twisted-pair cable for data signaling with characteristic impedance between 100 and 130 ohms. Distributed capacitance between conductors shall be less than 100 pF per meter (30 pF per foot). Distributed capacitance between conductors and shield shall be less than 200 pF per meter (60 pF per foot). Foil or braided shields are acceptable.

## LINE TERMINATION

On last node on either end of bus only connect 120Ω termination resistor between (+) and (-).

## MAXIMUM LENGTH

The maximum recommended length per segment is 1200 meters (4000 feet) with AWG 18 (0.82 mm<sup>2</sup> conductor area) cable.

## SHIELD CONNECTION

See Ashrae Standard 135 for detailed recommendation regarding how to connect the shield depending on type of nodes present in network. Nenuotec Controls bus modules are isolated devices.

## LED INDICATOR

A status LED is located on the upper left side of the controller housing. During normal operation the LED blinks briefly once every 5 seconds. If there is an alarm or fault condition it will blink every second.

The BACnet interface features a green LED and a red LED for indication of traffic on the RS-485 bus. The green LED is lit when an incoming packet is received, and the red LED is lit when an outgoing packet is transmitted to the bus.

At power-up, both LED blink twice simultaneously as a sign of the boot process being completed. A constantly lit LED serves as an indication of a fault condition in the reception or sending process.

# NPB SERIES

## BACNET COMMUNICATING CONTROLLER

### BACNET® SPECIFICATION

#### PROTOCOL IMPLEMENTATION CONFORMANCE STATEMENT (PICS)

Vendor Name: **NENUTEC**

Product Name: NPB Controls series

NPB product description: The NPB communicating BACnet® controllers are designed as universal controls equipment suitable for a large number of applications. They may be used in zoning and other applications which are monitored by a BACnet® MS/TP network.

#### SUPPORTED BACNET® INTEROPERABILITY BLOCKS (BIBB)

The BACnet® interface conforms to the B-ASC device profile (BACnet® Application Specific Controller). The following BACnet® Interoperability Building Blocks (BIBB) is supported.

BIBB	TYPE	NAME
DS-RP-B	Data sharing	Read property - B
DS-RPM-B	Data sharing	Read property multiple - B
DS-WP-B	Data sharing	Write property - B
DM-DCC-B	Device management	Device communication Control - B
DM-DDB-B	Device management	Dynamic device binding - B
DM-DOB-B	Device management	Dynamic object binding - B
DM-TS-B	Device management	Time synchronisation - B
DM-UTC-B	Device management	UTC Time synchronisation - B
DM-RD-B	Device management	Reinitialize device - B

#### SUPPORTED STANDARD BACNET® APPLICATION SERVICES

Read Property	I-Am	I-Have
Read Property Multiple	Device Communication Needs a password which is "Nenu" (case sensitive and without the quotes)	Reinitialize Device ("cold" or "warm"). Needs a password which is "Nenu" (case sensitive and without the quotes).
Write Property	UTC Time Synchronisation	Time Synchronisation


#### SUPPORTED STANDARD OBJECT TYPES

- Device
- Analog input
- Analog value
- Binary value
- Multi-state value

#### LED INDICATORS

The BACnet® interface features a green LED and a red LED for indication of traffic on the RS-485 bus. The green LED is lit when an incoming packet is received, and the red LED is lit when an outgoing packet is transmitted to the bus. At power-up, both LED blink twice simultaneously as a sign of the boot process being completed. A constantly lit LED serves as an indication of a fault condition in the reception or sending process.

## DIMENSION (mm)

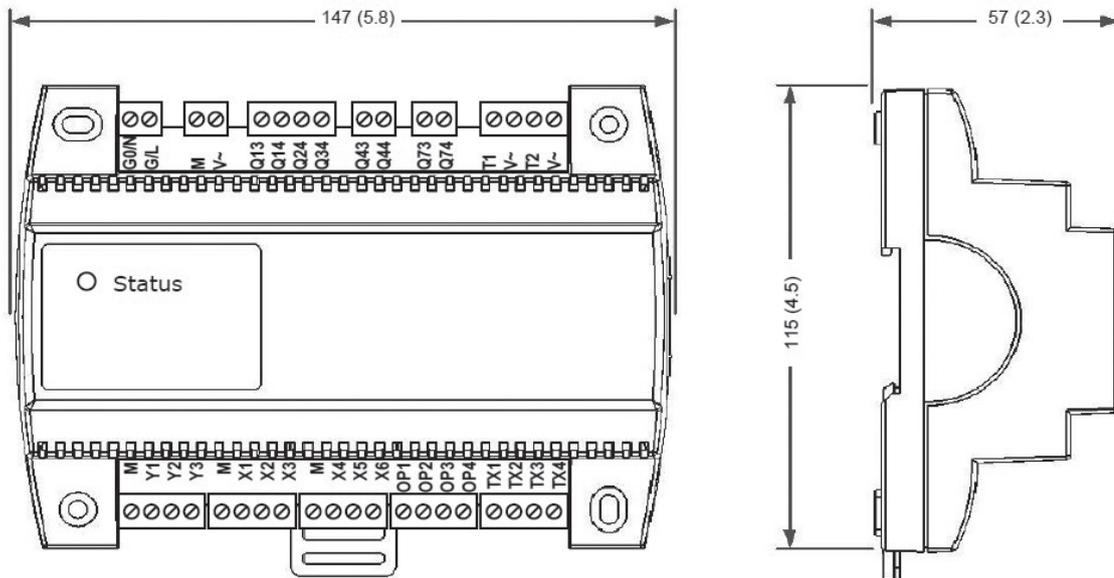

## SELECTION OF ACTUATORS AND SENSORS

<b>TEMPERATURE SENSOR</b>	For connections on X1 to X3 use NenuTec NTC sensors to achieve maximum accuracy
<b>ACTUATOR</b>	Choose modulating actuators with an input signal type of 0/2-10 VDC. 3-point actuators with constant running time are recommended
<b>BINARY AUXILIARY DEVICES (E.G. PUMPS, FANS, ON/OFF VALVES, HUMIDIFIERS, ETC.)</b>	Do not directly connect devices that exceed specified limits in technical specifications – observe startup current on inductive loads
<b>ELECTRICAL CONNECTION</b>	Use only twisted pair copper conductors for input connections. The operating voltage must comply with the requirements for safety extra-low voltage (SELV) as per EN 60 730
<b>FOR DEVICE WITH 24VAC POWER SUPPLY</b>	Use safety insulating transformers with double insulation. They must be designed for 100% ON-time. When using several transformers in one system the connection terminal 1 must be galvanically connected. The NPB is designed for operation by AC 24 V, max. 10 Amp, safety extra-low voltage that is short-circuit-proof. Supplying voltages above AC 24 V may damage or destroy the controller or any other connected devices  Additionally, connections to voltages exceeding 42 V endanger personnel safety. Observe limits mentioned in the technical specifications. Local regulations must be observed at all times.

The performance specifications are nominal and conform to acceptable industry standards. NENU TEC shall not be liable for damages resulting from misapplication or misuse of its products.